


1/25

FIG.1

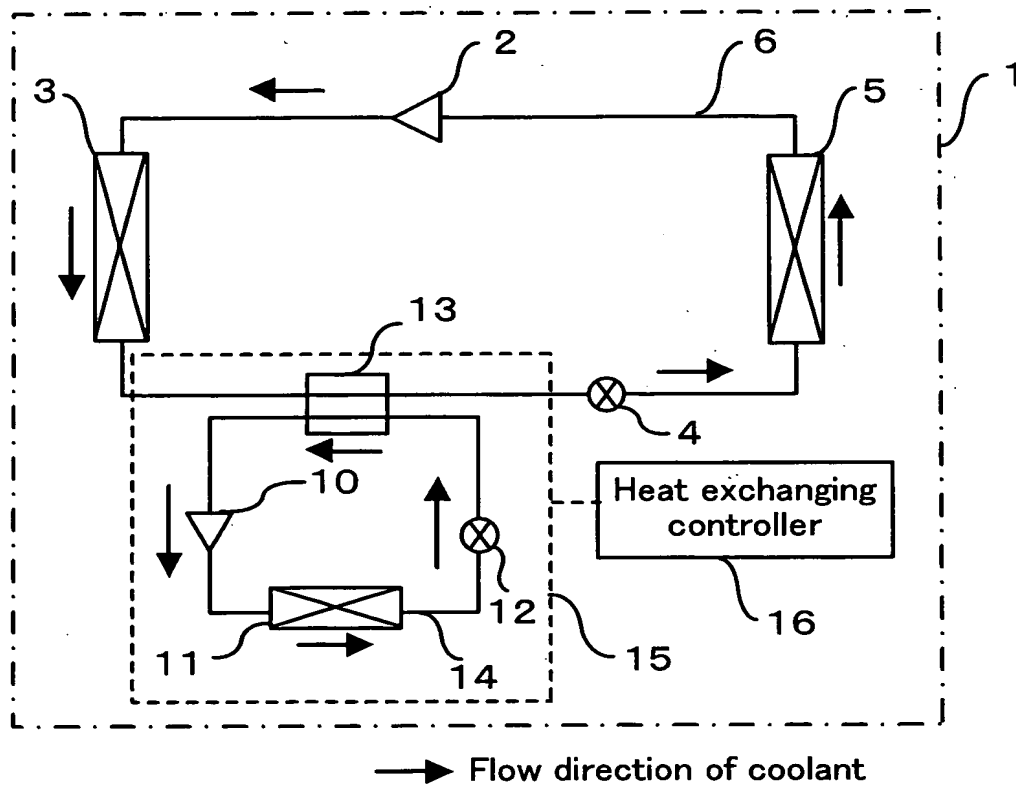

2/25

FIG.2


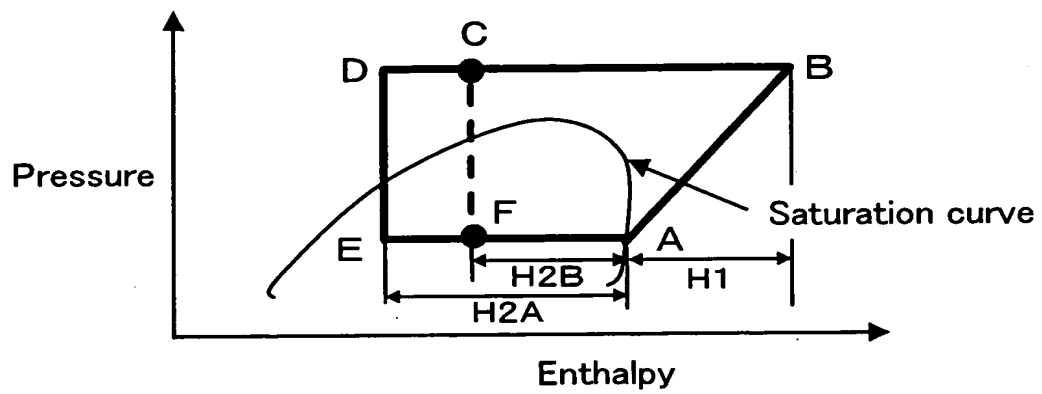



FIG.3



4 / 25
 FIG.4

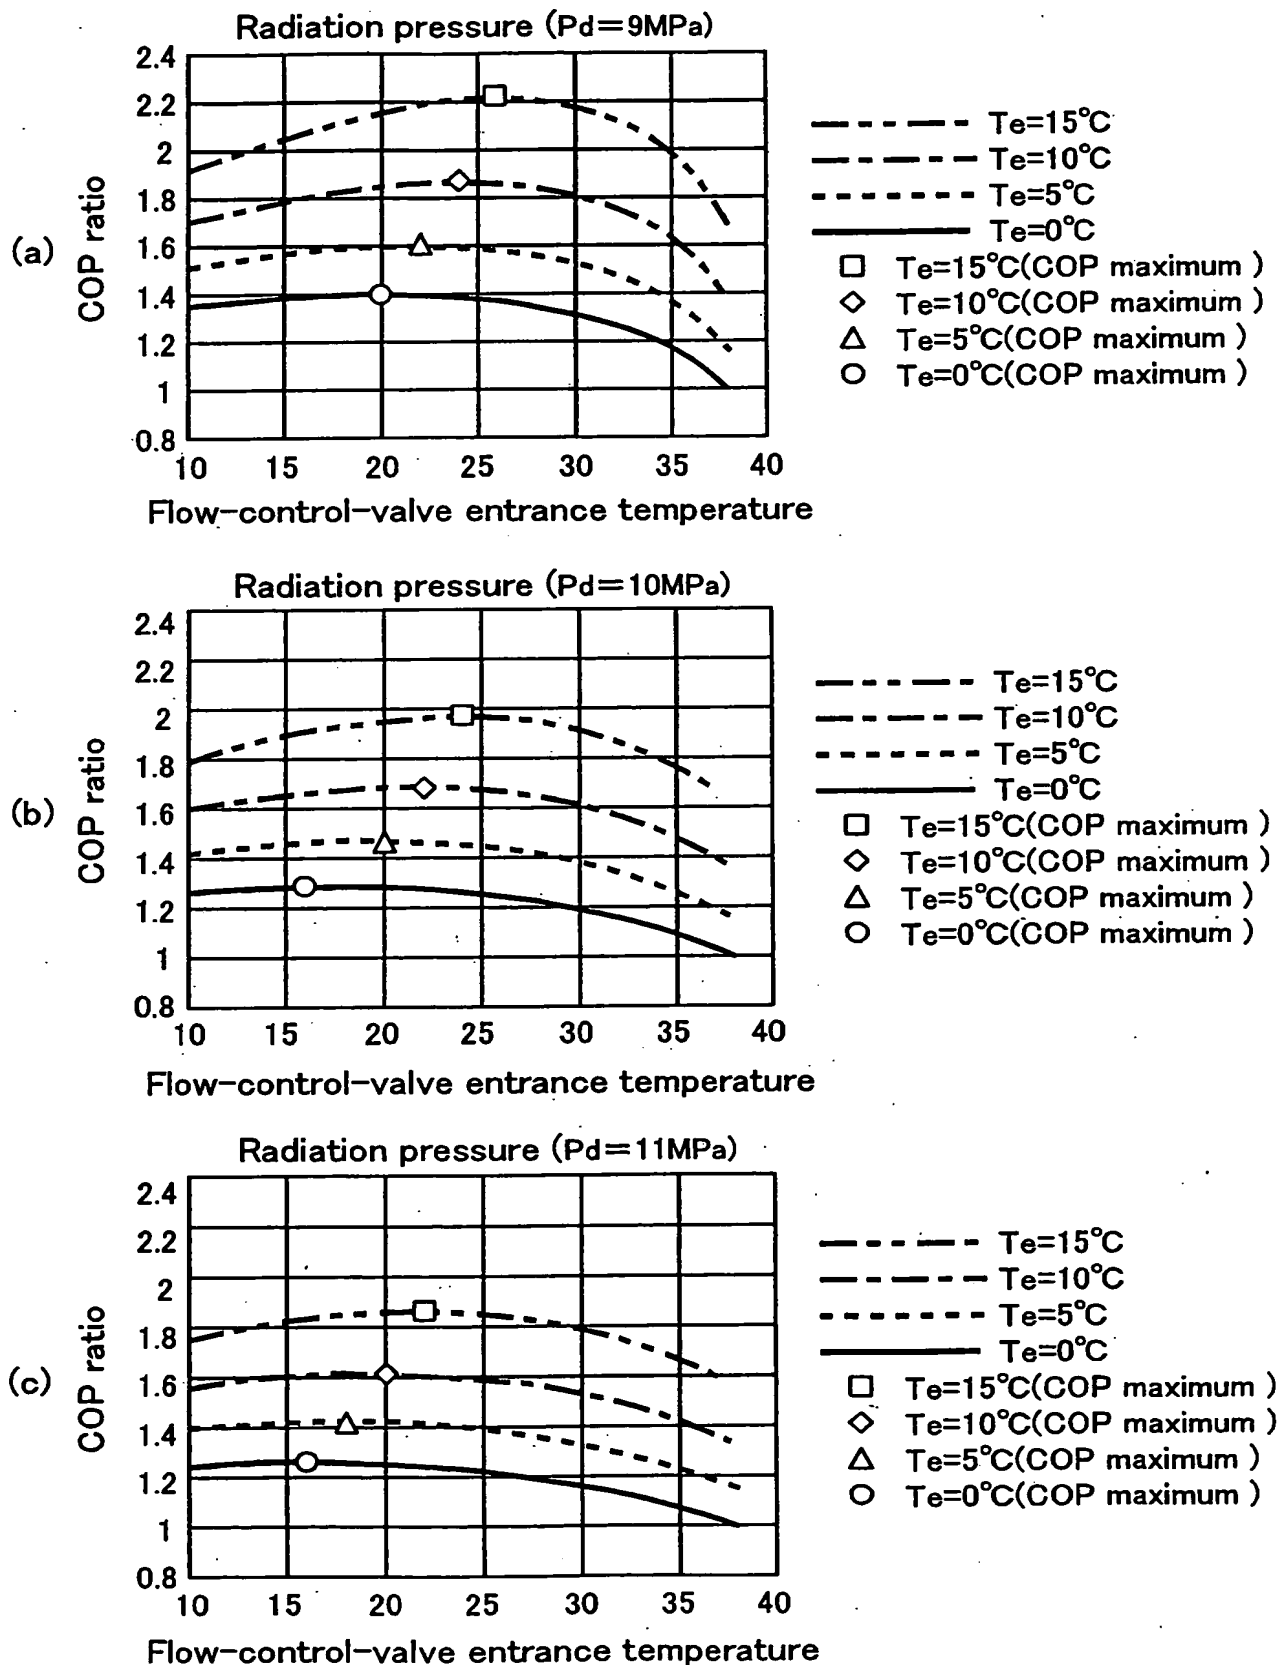


5 / 25
 FIG.5

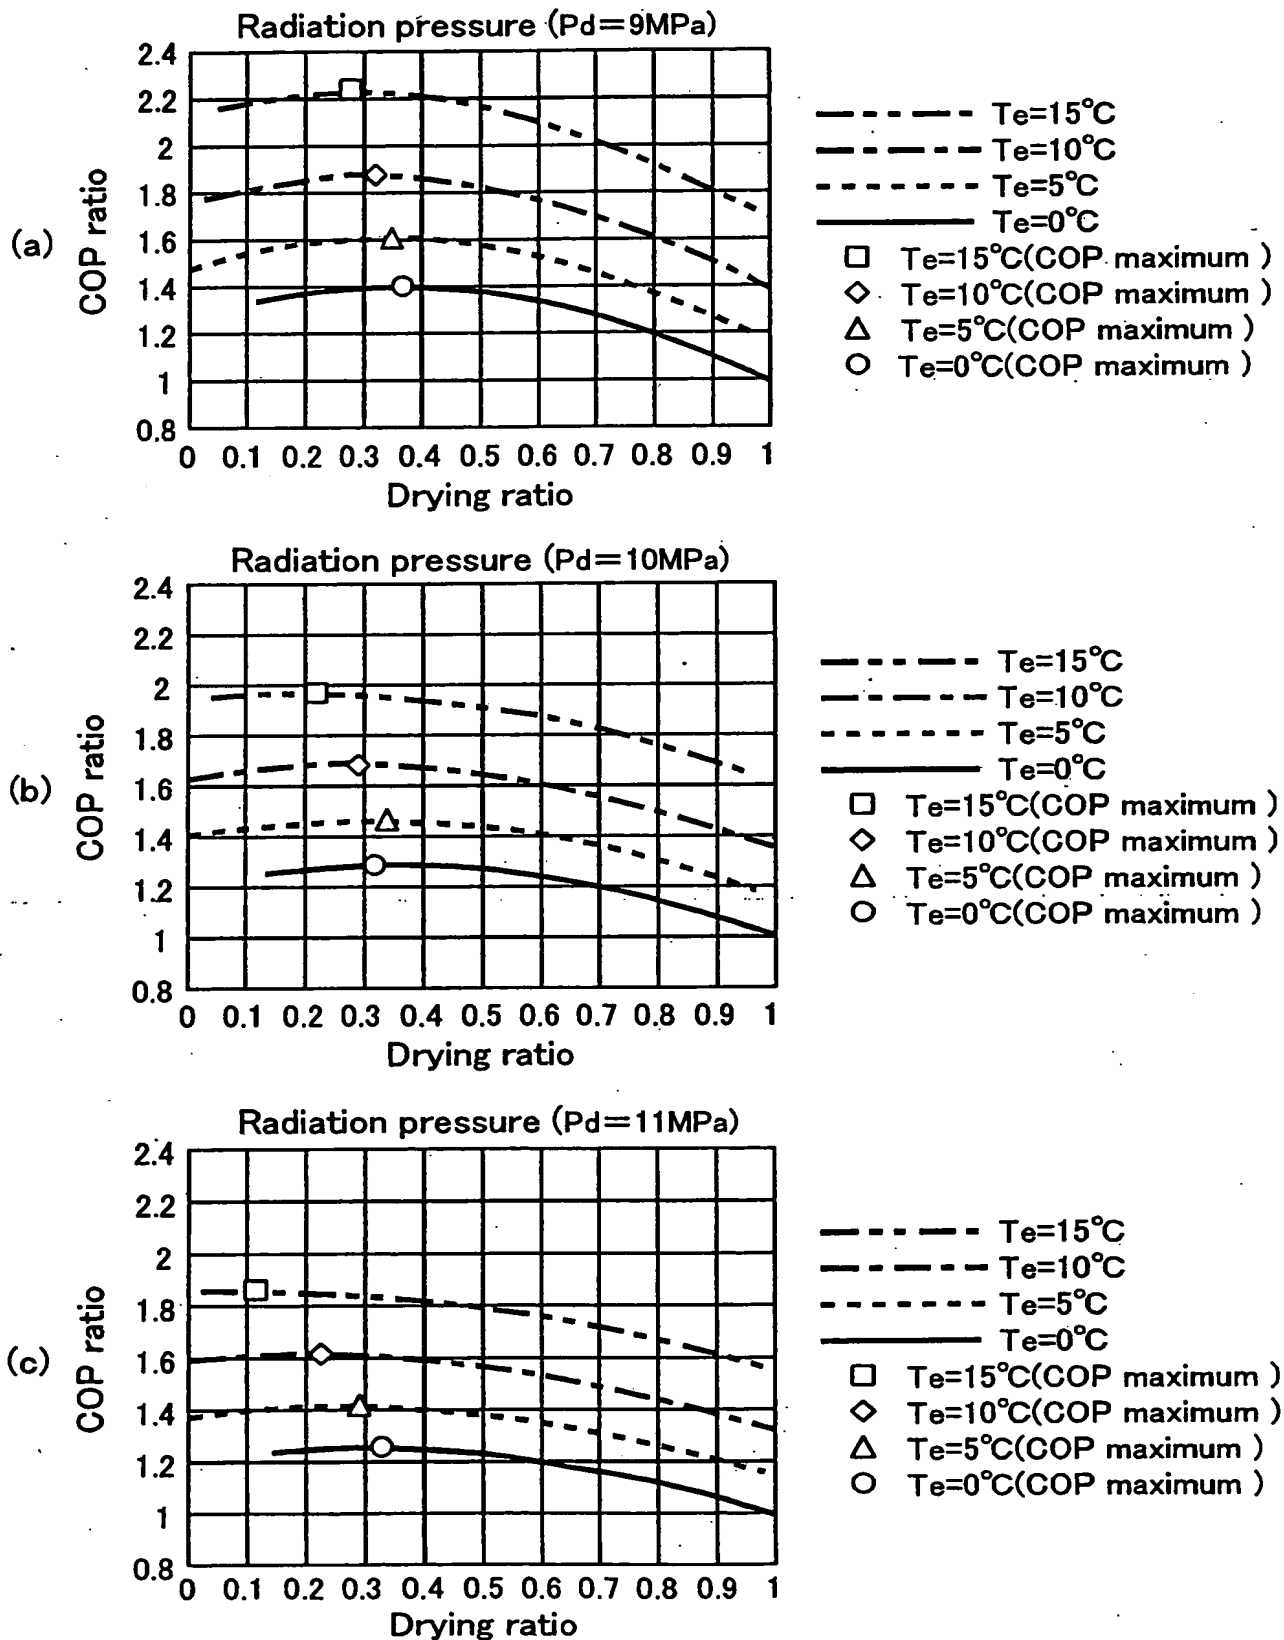

6/25


FIG.6

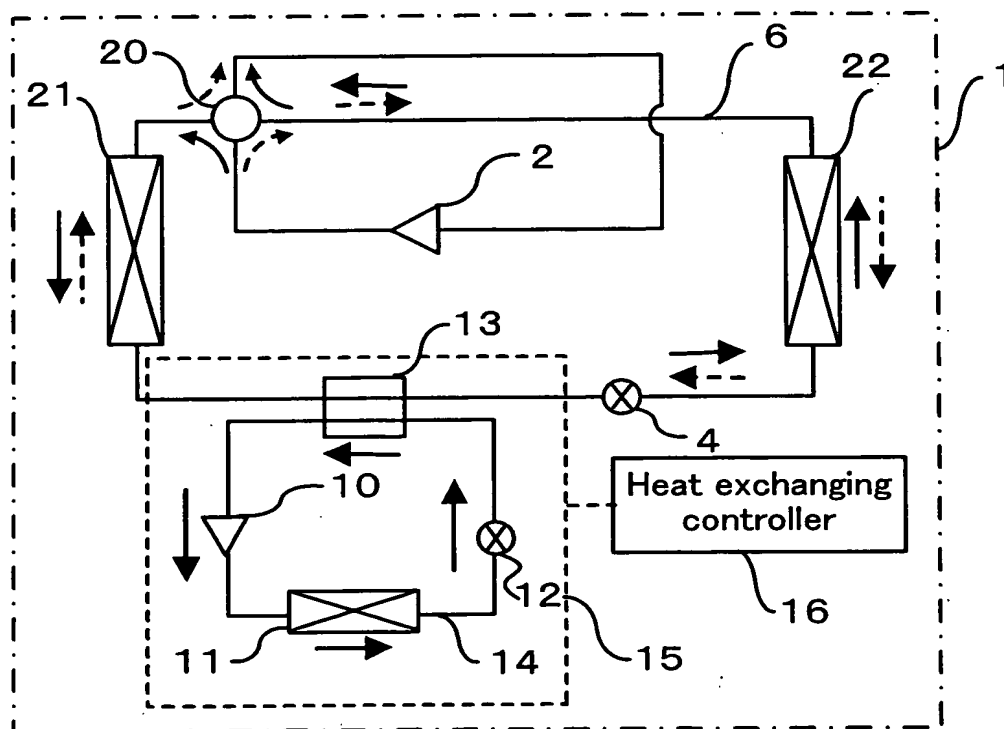


→ During cooling operation
--→ During warming operation

7/25


FIG.7

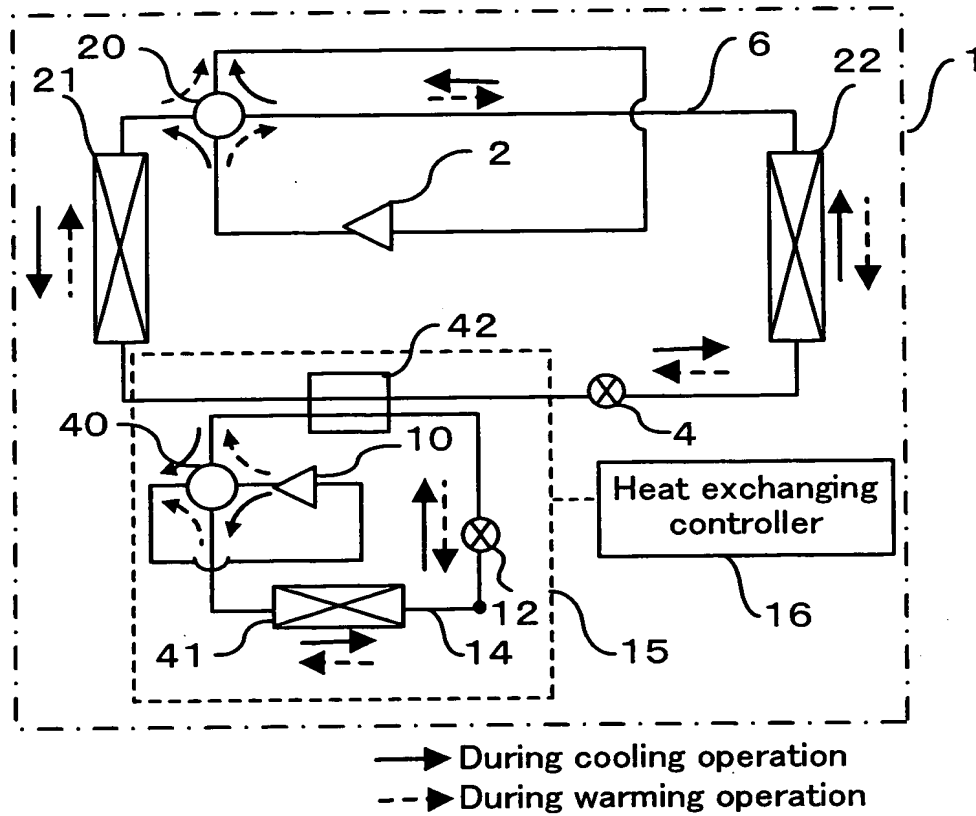

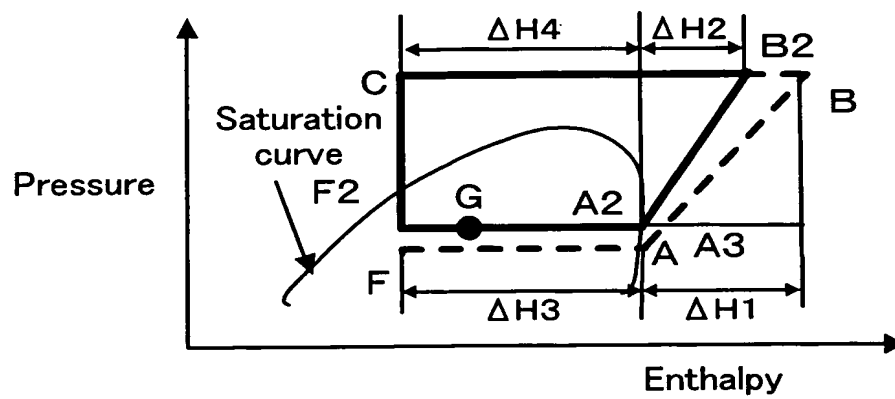


9/25

FIG.9

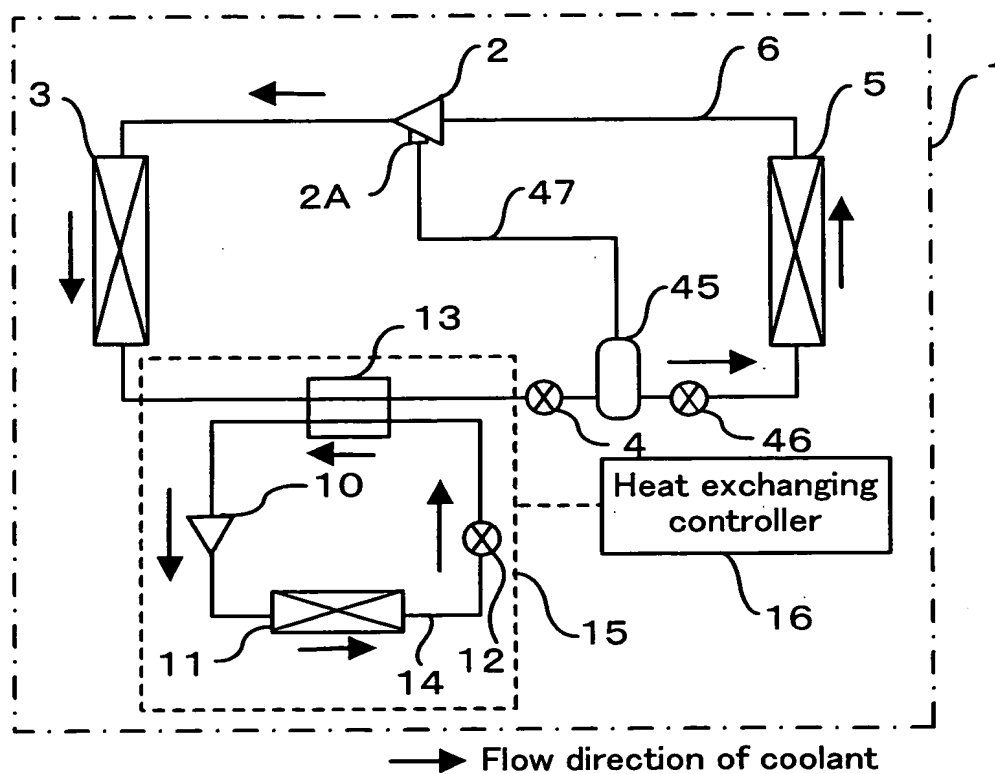


10/25

FIG.10

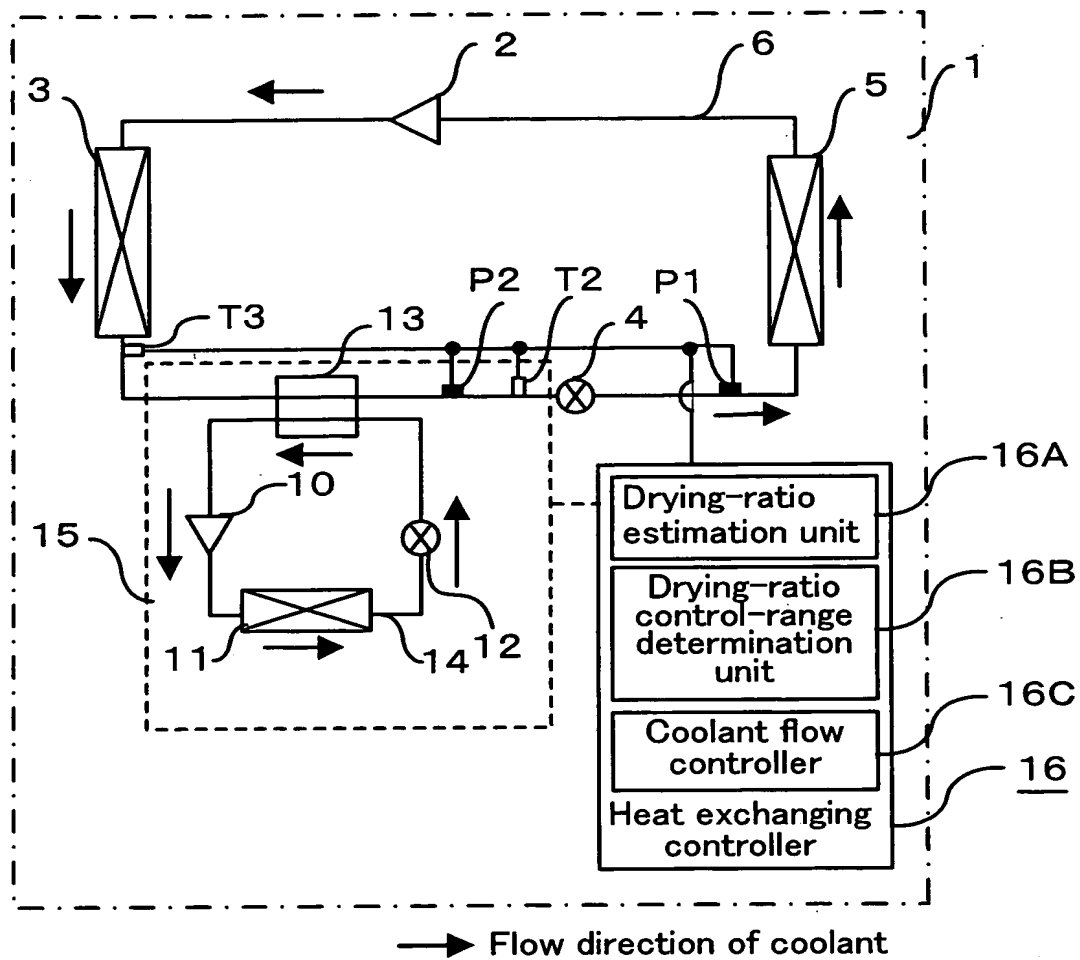


11/25

FIG.11

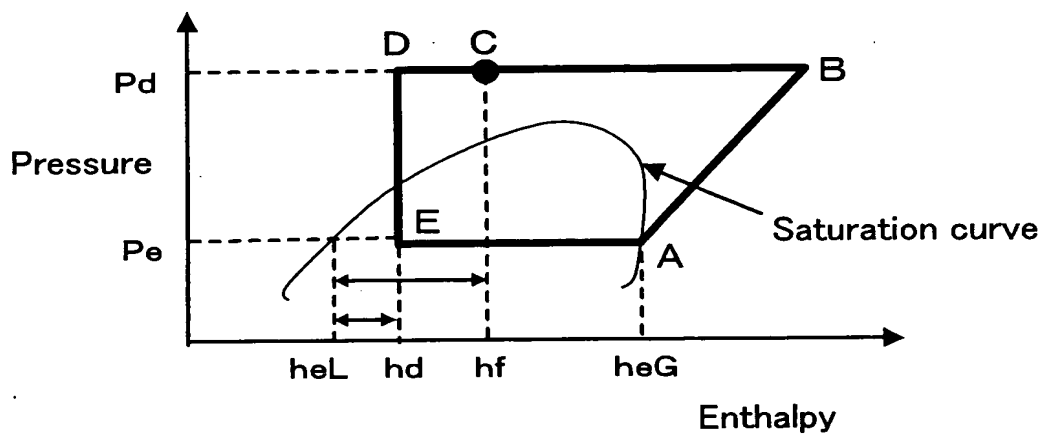


12/25

FIG.12

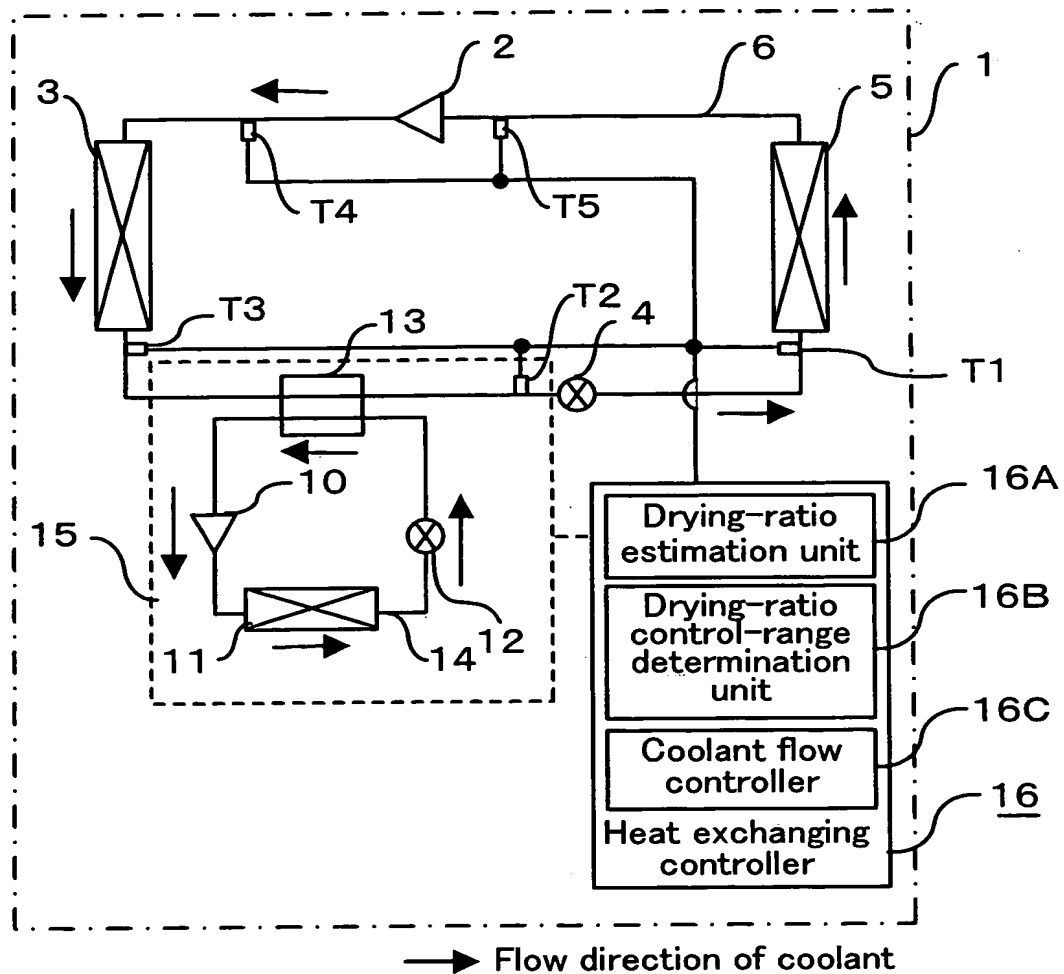


13/25

FIG.13

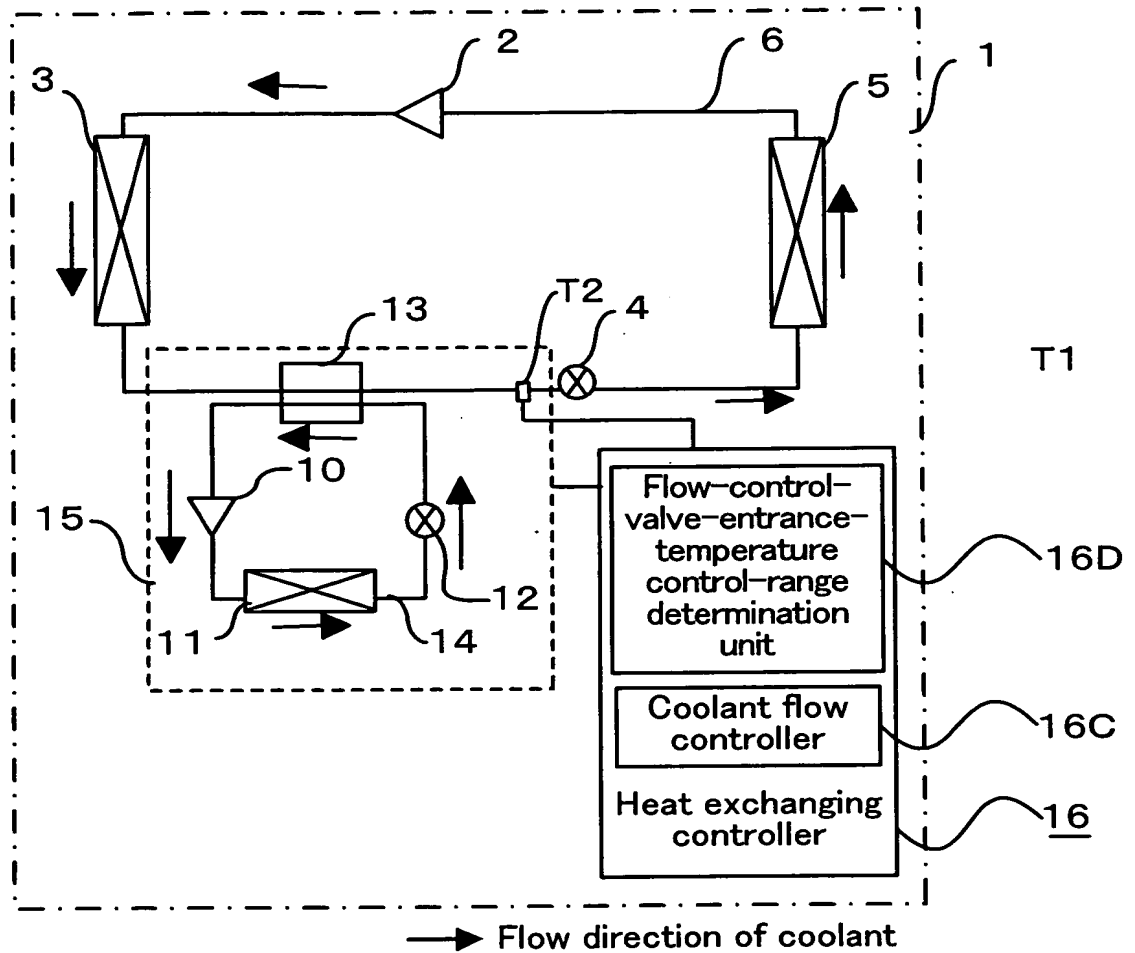


14/25

FIG.14

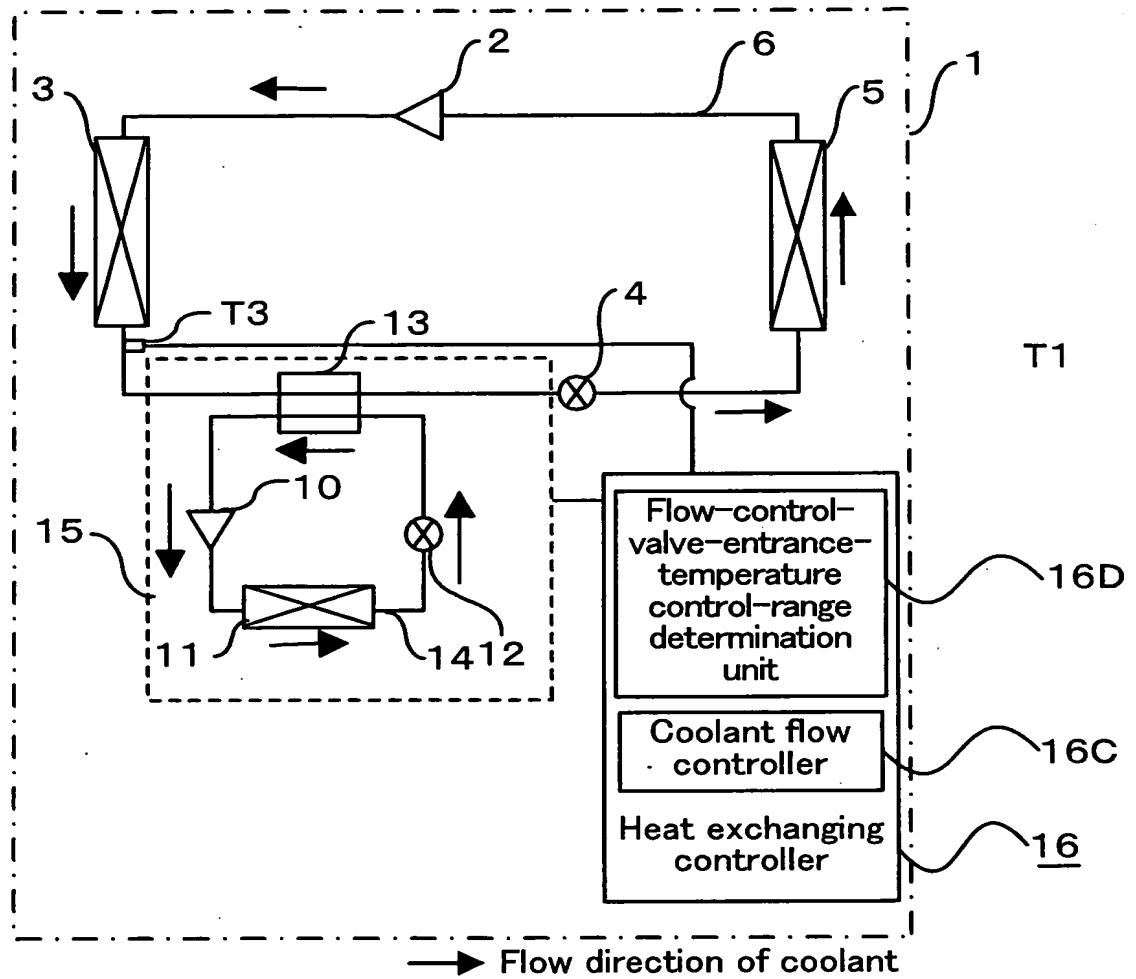


15/25

FIG.15

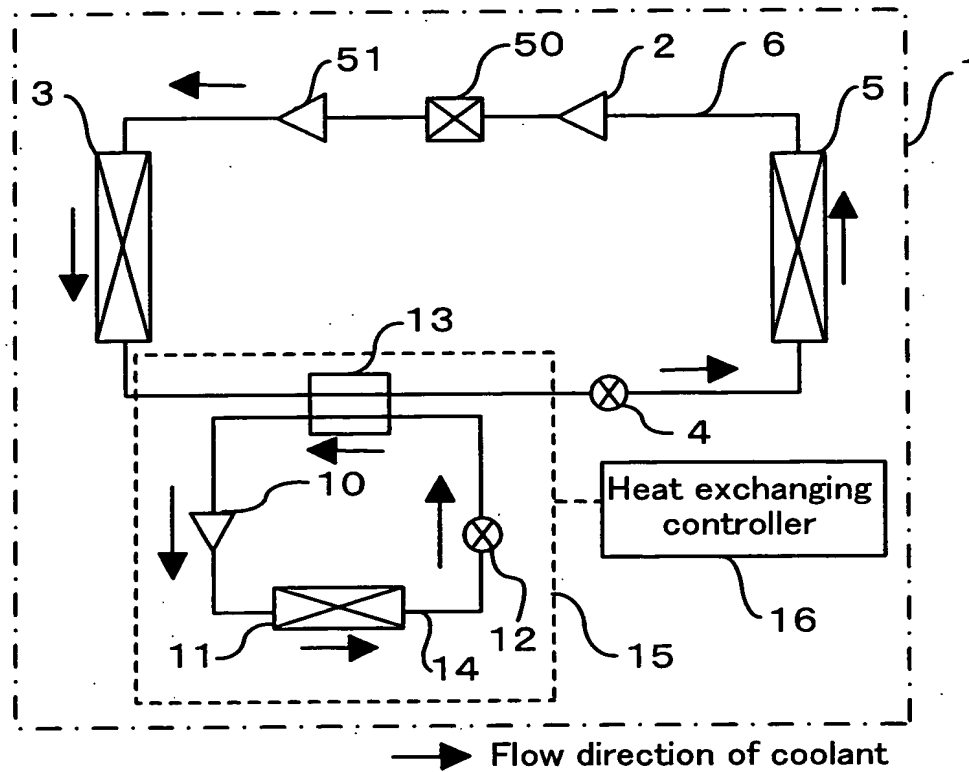


16/25

FIG.16

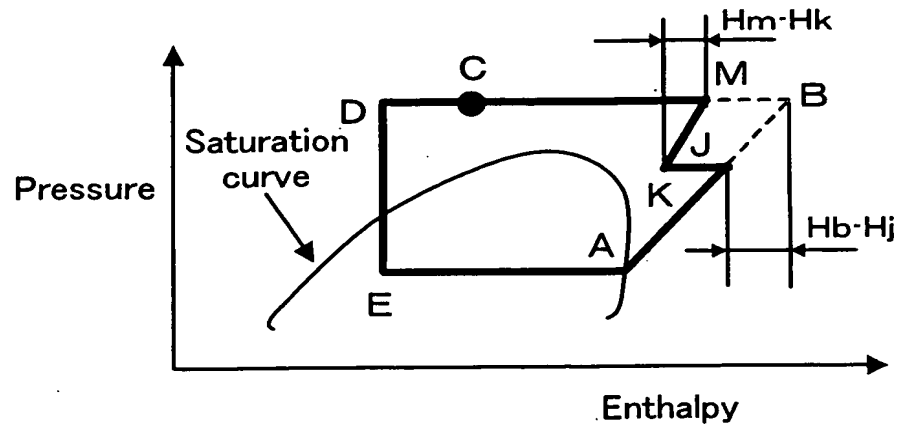


17/25

FIG.17

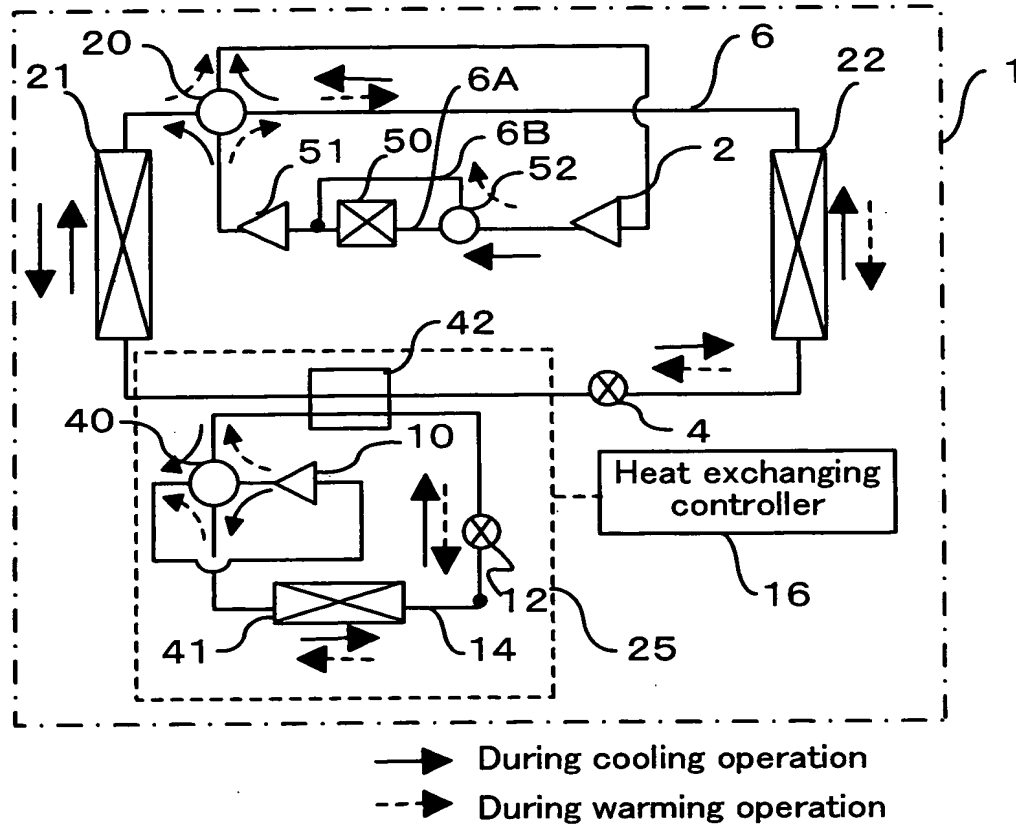


18/25

FIG.18

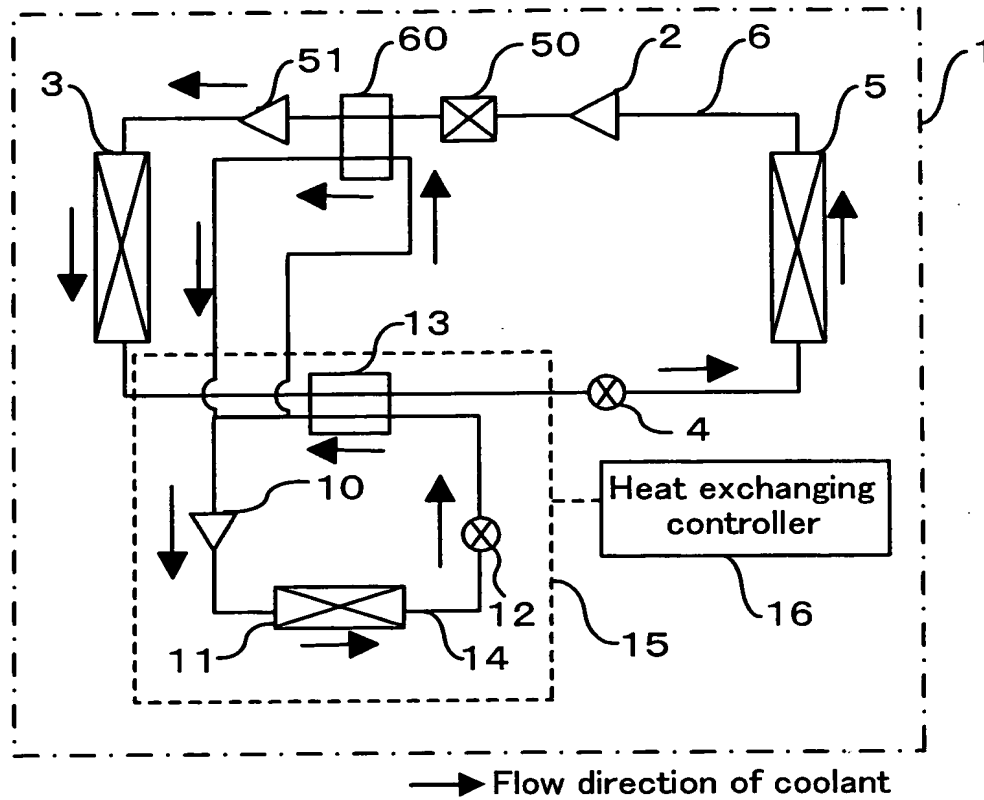


19/25

FIG.19

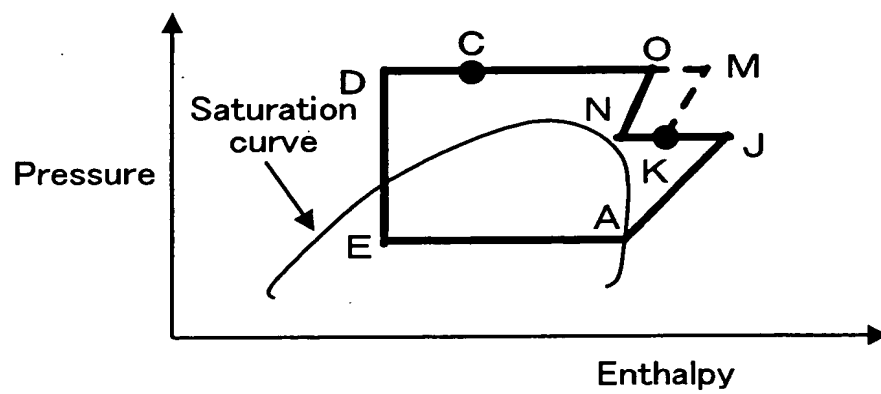


20/25

FIG.20

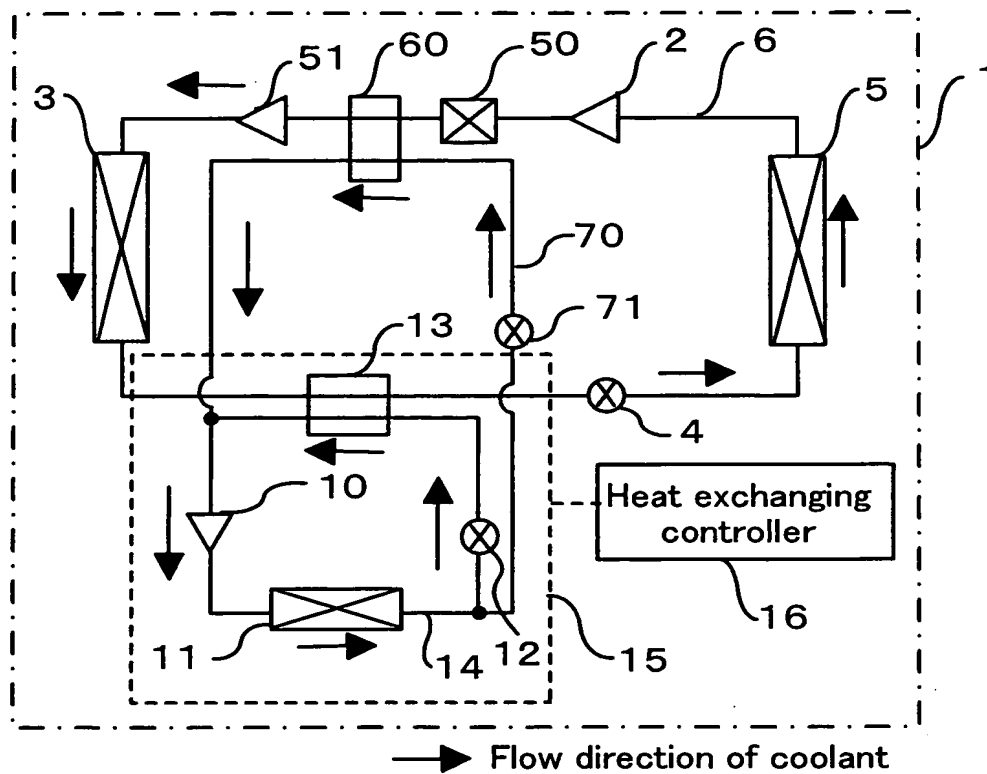


21/25

FIG.21

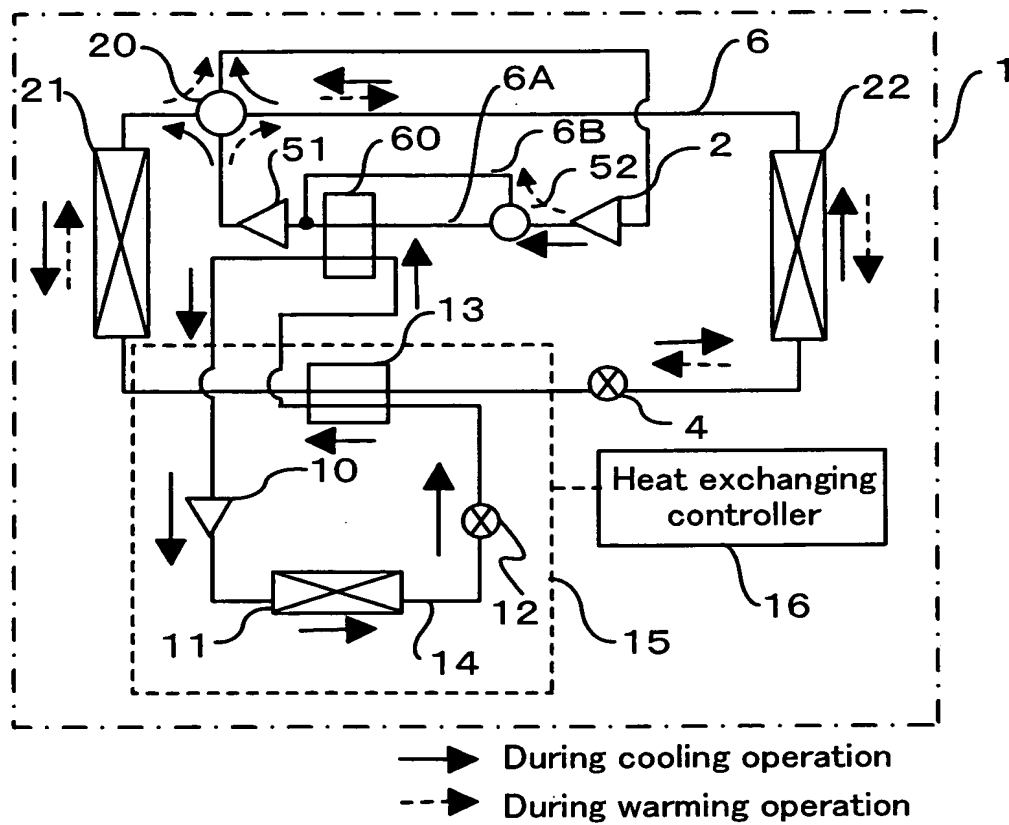


22/25

FIG.22

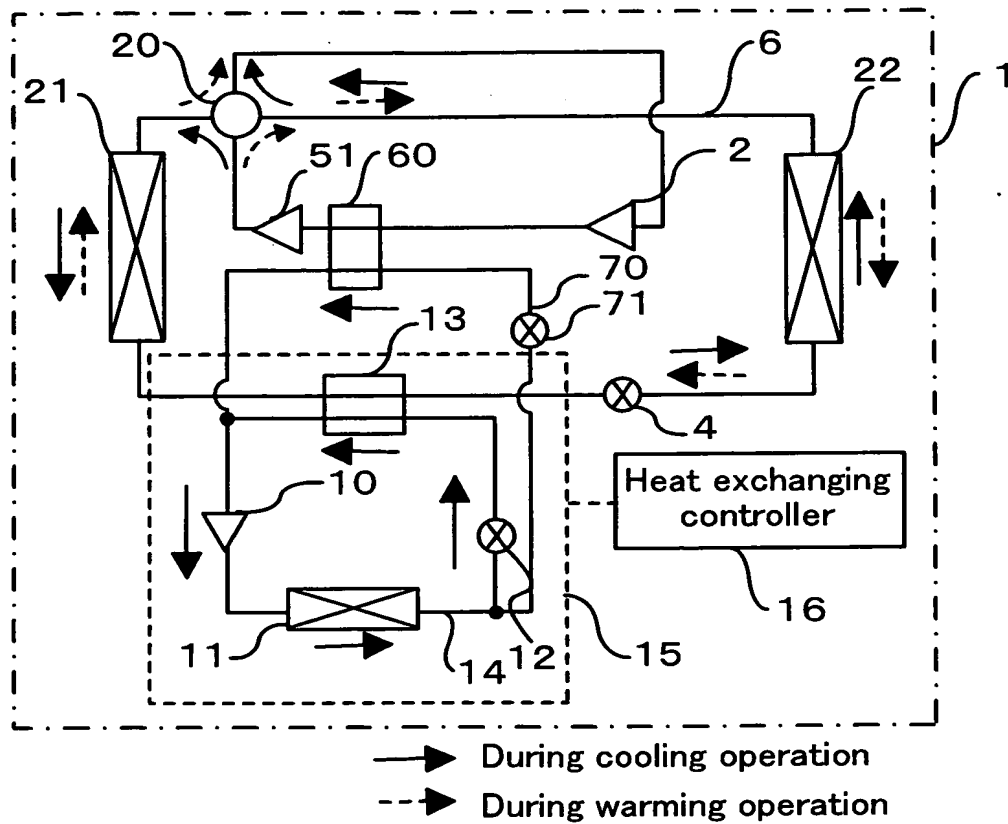


23/25

FIG.23

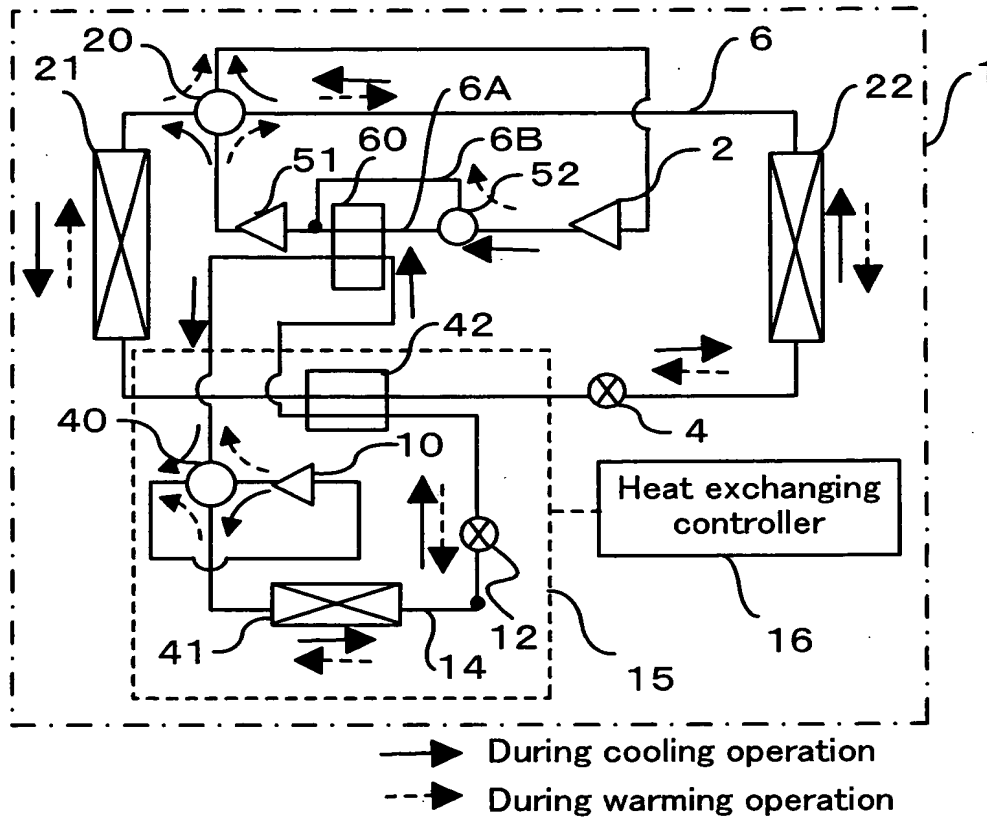

24/25

FIG.24

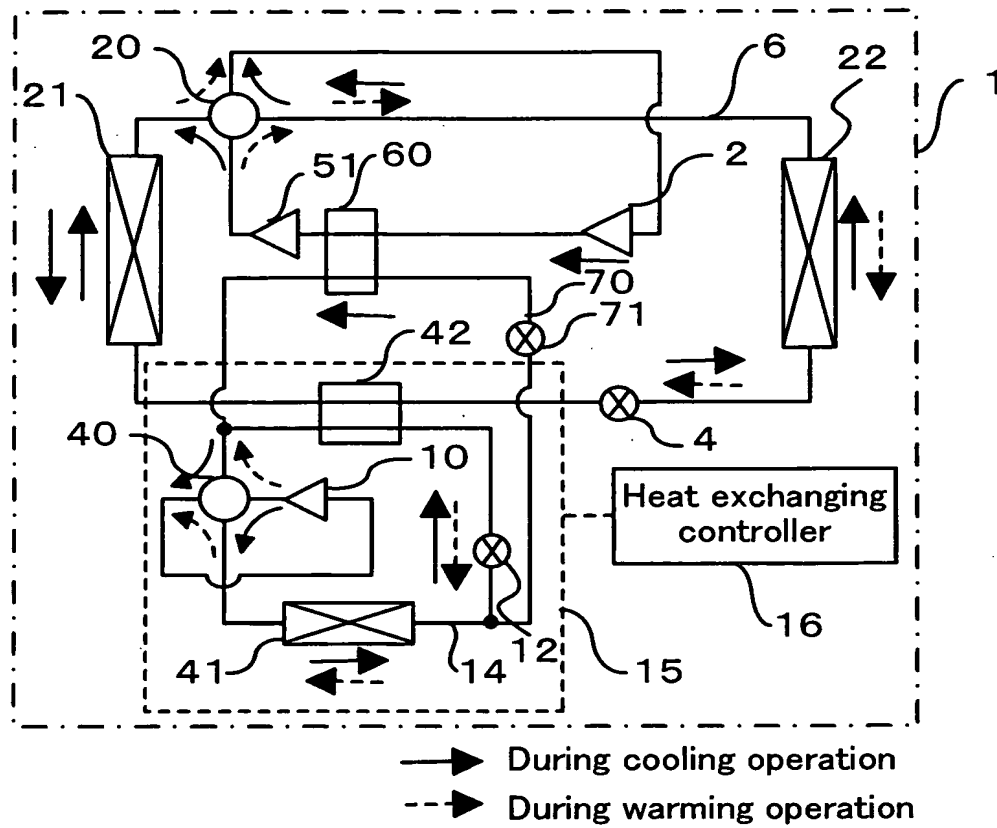

25/25

FIG.25

